


1. **CIVIL SPEC. 1323 NOTES:**
2. **BC HYDRO UNDERGROUND CIVIL INSPECTOR MUST BE NOTIFIED 48 HOURS PRIOR TO CONSTRUCTION.**
3. **ALL WORK TO BE PERFORMED IN ACCORDANCE WITH THE CITY OF VICTORIA WORK PRACTICES AND BC HYDRO UNDERGROUND DISTRIBUTION ENGINEERING STANDARDS SERIES ES53 AND ES54.**
4. **ANY CHANGES NEED TO HAVE PRIOR APPROVAL OF BC HYDRO CIVIL INSPECTOR.**
5. **ALL CONDUIT INSTALLATION FOR BC HYDRO ON PUBLIC OR PRIVATE PROPERTY SHOULD HAVE MIN. 0.9m COVER AND ANY FACTORY BEND MUST HAVE A MIN. RADIUS OF 0.9m.**
6. **ALL UTILITIES (EXCEPT TELUS) MUST MAINTAIN A 0.9m HORIZONTAL AND 0.3m VERTICAL SEPARATION FROM BC HYDRO DUCT UNLESS DIRECTED OTHERWISE BY BC HYDRO CIVIL INSPECTOR.**
7. **OTHER UTILITIES SHOWN ON THE CIVIL DRAWING ARE FOR REFERENCE ONLY. PROVE LOCATION OF ALL UTILITIES IN THE WORK AREA BEFORE CONSTRUCTION. FOR CURRENT INFORMATION CONTACT BC ONE CALL.**
8. **ALL CURBS INDICATE CENTERLINE OF BC HYDRO PLANT.**
9. **METRES EXPRESSED IN DECIMALS, MILLIMETRES IN WHOLE NUMBERS.**
10. **ALL FORMER MUST BE A MIN. OF 15mm THICK NON-MOUNTABLE CURB OR PROTECTED. FINAL NUMBER AND LOCATION OF PROTECTION POSTS TO BE DETERMINED IN THE FIELD BY BC HYDRO CIVIL INSPECTOR.**
11. **FOR TRANSFORMER PAD COUNTERPOISE CLEARANCES TO OTHER UTILITIES AND UNDERGROUND CONDUCTIVE SURFACES, SEE ES54.**
12. **FOR PROTECT FOR BC HYDRO DUCTS, IN JOINT TRENCH, FROM PROPERTY LINE IS 1.2m, UNLESS OTHERWISE NOTED.**
13. **STUB SERVICE DUCT 1.0m FROM PROPERTY CORNER AND 1.0m INTO THE LOT UNLESS OTHERWISE NOTED.**
14. **IT IS THE RESPONSIBILITY OF THE RESOURCE THAT IS PERFORMING THE INSTALLATION OF THE PROPOSED CIVIL WORKS TO PROVIDE BC HYDRO WITH A RECORD DRAWING(S) OF THE CONSTRUCTION, THE RECORD DRAWING(S) MUST BE RECEIVED AND ACCEPTED BEFORE ELECTRICAL WORK WILL COMMENCE.**

CUSTOM NOTES HERE IF REQUIRED

CIVIL PLAN LEGEND:

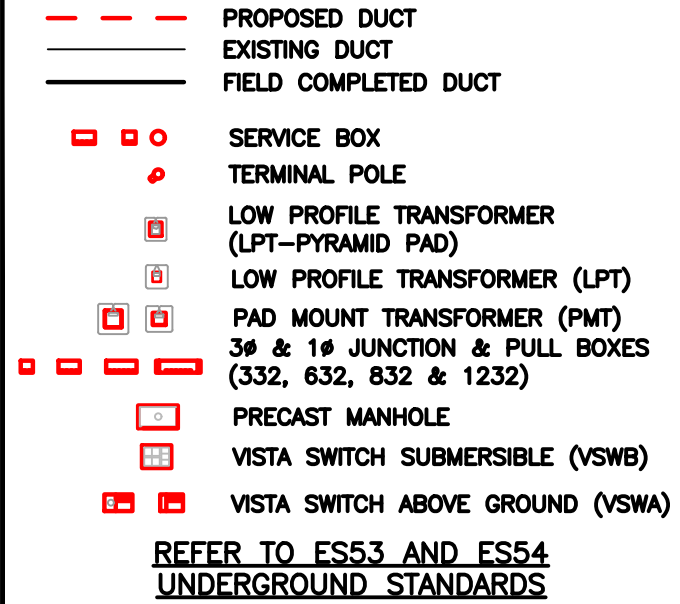

CSA S250 ACCURACY	NAD 83 - 10 UTM
-------------------	-----------------

BASE ACCURACY LEVEL: $4 \pm / - 1000$ mm

ACB ACCURACY LEVEL 1 : 1000



CENTRAL VANCOUVER ISLAND
NANAIMO POWER DISTRICT
 UNDERGROUND DUCT AND STRUCTURES FOR
 800A 120/208V SERVICE UPGRADE TO HAMMOND BAY SCHOOL
 1025 MORNINGSIDE DRIVE
 NANAIMO

5	----	5										BCH MAP	----	INDEP CHK	----
4	----	4										DESIGN#	0004312067	DFTG CHK	E.HOEKSTRA
3	----	3										WO#	0	DFTG CHK	T.BELLAVIE
2	----	2										DESIGN#	000	INSP	----
1	----	1	ISSUED FOR CONSTRUCTION	2021MAR24	D.HARAPNUK		TB					WO#	0	REV	----
REF#	DRAWING NUMBER	NO	REMARKS	DATE	DESIGNED	INDEP CHK	DFTG	DFTG CHK	INSP	REV	ACPT			ACPT	----
REFERENCE DRAWINGS			REVISIONS												